

## ▶ PSSu E F 4DO 0.5(-T)(-R)

# PILZ

THE SPIRIT OF SAFETY

Operating Manual-21316-EN-10

- Decentralised system PSSuniversal I/O



This document is the original document.

Where unavoidable, for reasons of readability, the masculine form has been selected when formulating this document. We do assure you that all persons are regarded without discrimination and on an equal basis.

All rights to this documentation are reserved by Pilz GmbH & Co. KG. Copies may be made for the user's internal purposes. Suggestions and comments for improving this documentation will be gratefully received.

Pilz®, PIT®, PMI®, PNOZ®, Primo®, PSEN®, PSS®, PVIS®, SafetyBUS p®, SafetyEYE®, SafetyNET p®, the spirit of safety® are registered and protected trademarks of Pilz GmbH & Co. KG in some countries.



SD means Secure Digital

<b>1</b>	<b>Introduction</b>	<b>5</b>
1.1	Validity of documentation	5
1.1.1	Retaining the documentation	5
1.1.2	Terminology: System environment A and B	5
1.2	Definition of symbols	6
<b>2</b>	<b>Overview</b>	<b>7</b>
2.1	Module structure	7
2.2	Module features	7
2.3	Front view	8
<b>3</b>	<b>Safety</b>	<b>10</b>
3.1	Intended use	10
3.2	Safety regulations	13
3.2.1	Use of qualified personnel	13
3.2.2	Warranty and liability	13
3.2.3	Disposal	13
<b>4</b>	<b>Function description</b>	<b>14</b>
4.1	Block diagram	14
4.2	Module features	14
4.2.1	Functions	14
4.2.2	Integrated protection mechanisms	17
4.2.3	Reaction times	17
4.3	Configuration	18
4.3.1	PSSu assignment in system environment A	18
4.3.1.1	Addresses in the process image	18
4.3.2	PSSu assignment in system environment B	18
<b>5</b>	<b>Installation</b>	<b>19</b>
5.1	General installation guidelines	19
5.1.1	Dimensions	19
5.2	Installing the base module	20
5.3	Inserting and removing an electronic module	21
5.3.1	Inserting an electronic module	22
5.3.2	Removing an electronic module	23
5.3.3	Changing an electronic module during operation	23
<b>6</b>	<b>Wiring</b>	<b>24</b>
6.1	General wiring guidelines	24
6.1.1	Mechanical connection of the base modules	24
6.2	Terminal configuration	27
6.3	Connecting the module	29
6.4	Function test during commissioning	30
<b>7</b>	<b>Operation</b>	<b>31</b>
7.1	Messages	31
7.2	Display elements	32

7.2.1	Display elements for module diagnostics .....	32
7.2.2	Display elements for an output's FS enable .....	32
7.2.3	Display elements for output status .....	33
<b>8</b>	<b>Technical details</b> .....	<b>34</b>
8.1	Safety characteristic data .....	38
<b>9</b>	<b>Supplementary data</b> .....	<b>39</b>
9.1	Permitted operating height .....	39
<b>10</b>	<b>Order reference</b> .....	<b>40</b>
10.1	Product .....	40
10.2	Accessories .....	40
<b>11</b>	<b>EC declaration of conformity for PSSu E F 4DO 0.5 and PSSu E F 4DO 0.5-T</b> .....	<b>41</b>
<b>12</b>	<b>UKCA-Declaration of Conformity for PSSu E F 4DO 0.5 and PSSu E F 4DO 0.5-T</b> .....	<b>42</b>

# 1 Introduction

## 1.1 Validity of documentation

This documentation is valid for the product types PSSu E F 4DO 0.5, PSSu E F 4DO 0.5-T and PSSu E F 4DO 0.5-R. It is valid until new documentation is published.

This operating manual explains the function and operation, describes the installation and provides guidelines on how to connect the product.

### 1.1.1 Retaining the documentation

This documentation is intended for instruction and should be retained for future reference.

### 1.1.2 Terminology: System environment A and B

The PSSu system can be used in two different system environments. The module's application area is described in the chapter "Intended Use" of the manual.

The distinction is made between

- ▶ PSSu in system environment A
- ▶ PSSu in system environment B

The distinction is based on the application area of the PSSu system.

PSSu in system environment A may be used in the

- ▶ Decentralised system PSSu I/O
- ▶ **Not** in the automation system PSS 4000

PSSu in system environment B may be used in the

- ▶ Automation system PSS 4000, e.g. with
  - Decentralised system PSSu I/O with SafetyNET p
  - Control system PSSu PLC
  - Control system PSSu multi

## 1.2 Definition of symbols

Information that is particularly important is identified as follows:



### **DANGER!**

This warning must be heeded! It warns of a hazardous situation that poses an immediate threat of serious injury and death and indicates preventive measures that can be taken.



### **WARNING!**

This warning must be heeded! It warns of a hazardous situation that could lead to serious injury and death and indicates preventive measures that can be taken.



### **CAUTION!**

This refers to a hazard that can lead to a less serious or minor injury plus material damage, and also provides information on preventive measures that can be taken.



### **NOTICE**

This describes a situation in which the product or devices could be damaged and also provides information on preventive measures that can be taken. It also highlights areas within the text that are of particular importance.



### **INFORMATION**

This gives advice on applications and provides information on special features.

## 2 Overview

### 2.1 Module structure

A module consists of

- ▶ Electronic module and
- ▶ Base module with
  - Screw terminals or
  - Cage clamp terminals

The base modules are the carrier units for the electronic modules and are used to connect the field wiring. The electronic modules are inserted on to the base modules and determine the module's function.


Details of the base modules that can be used are available in the chapter entitled “Intended Use”.

### 2.2 Module features

The product has the following features:

- ▶ 4 Digital outputs
  - Semiconductor technology
  - Single-pole
  - Positive-switching
  - Current load capacity per output: 0,5 A
  - Short circuit-proof
  - Overload-proof
  - Free from feedback
- ▶ LEDs for:
  - Switch status per output
  - FS enable per output
  - Module error
- ▶ For failsafe applications in system environment A and B
- ▶ T-type:
  - PSSu E F 4DO 0.5-T: for increased environmental requirements
- ▶ R-type:
  - PSSu E F 4DO 0.5-R: for railway applications

## 2.3 Front view

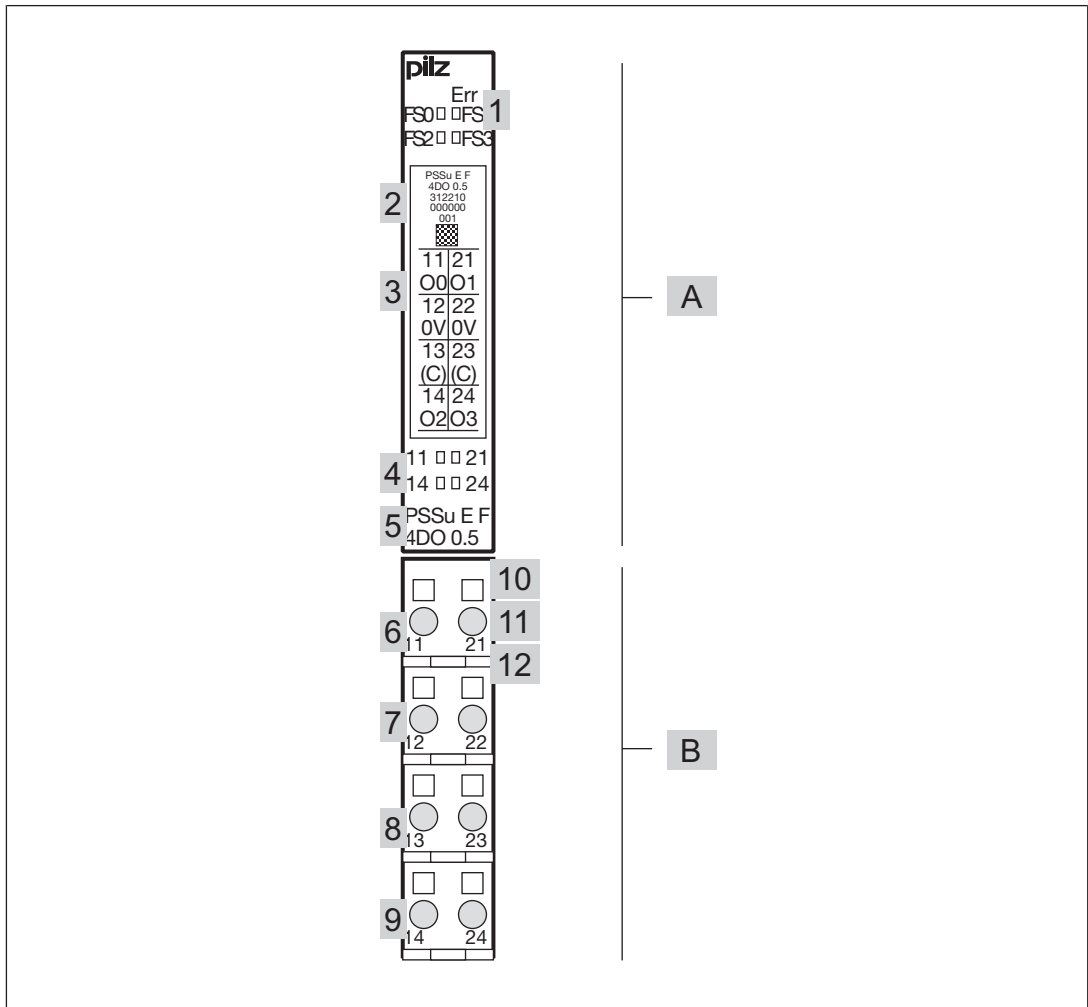

### Legend:

- ▶ A: Electronic module
- ▶ B: Base module
- ▶ 1: LEDs for
  - Module diagnostics
  - Displaying an output's FS enable (enable principle)
- ▶ 2: Labelling strip with:
  - Name of electronic module
  - Order number
  - Serial number
  - Hardware version number
  - 2D code
- ▶ 3: Labelling strip for the terminal configuration on the base module
- ▶ 4: Status LEDs
- ▶ 5: Name of electronic module
- ▶ 6: Connection level 1



- ▶ 7: Connection level 2
- ▶ 8: Connection level 3
- ▶ 9: Connection level 4
- ▶ 10: Square mounting holes (connection levels 1, 2, 3 and 4)
  - With screw to loosen/tighten the screw terminal on base modules with screw terminals
  - With mechanism to operate the cage clamp on base modules with cage clamp terminals
- ▶ 11: Round connection holes (connection levels 1, 2, 3 and 4) for connecting the signal lines
- ▶ 12: Mounting slot for colour marker to label the connection level (connection levels 1, 2, 3 and 4)

## 3 Safety

### 3.1 Intended use



#### INFORMATION

If the module name is not explicitly named, the details apply to all the variants of the module.

#### Use in a PSSu system

The module may be used in a PSSu system in system environment A and B.

The head module establishes in what system environment a PSSu system can be used.

##### ▶ System environment A

A PSSu system in system environment A is a decentralised system PSSu I/O with a field-bus, but without SafetyNET p interface. The automation system PSS 4000 does **not** belong to the system environment A.

##### ▶ System environment

A PSSu system in system environment B is a PSSu system in the h automation system PSS 4000. The PSSu system can belong to one of the following performance classes:

- Decentralised system PSSu I/O (with SafetyNET p)
- Control system PSSu PLC
- Control system PSSu multi

#### Failsafe applications

The module may be used for failsafe applications.

The module meets the requirements of EN IEC 61508 up to SIL 3.

#### Failsafe outputs

The module has failsafe outputs.


It provides type 1 failsafe outputs in accordance with IEC 61131-2.

The outputs may be used to switch:

- ▶ Resistive loads
- ▶ Inductive loads
- ▶ Capacitive loads


#### Particular application areas

##### ▶ Increased environmental requirements


The module PSSu E F 4DO 0.5-T is suitable for use where there are increased environmental requirements (see [Technical details](#) [ 38]).

##### ▶ Lift applications


The modules PSSu E F 4DO 0.5 and PSSu E F 4DO 0.5-T can be used as a PESSRAL (programmable electronic system in safety-related applications for lifts) in accordance with the Lifts Directive 2014/33/EU. The modules meet the requirements in accordance with EN 81-20, EN 81-50 for passenger and goods lifts the requirements in accordance with EN 115-1 for escalators and moving walks.

The module/the safety controller should be installed in a protected environment. Example: Protected inside space or control cabinet with protection class and corresponding air conditioning specified in [Technical details](#) [ 38].

► **Railway applications**

The module PSSu E F 4DO 0.5-R is **only** intended and certified for use in railway applications (CENELEC) where there are increased environmental requirements (see [Technical details](#) [ 38]). Any other use is **not** permitted.

**Permitted operating height**

With reference to the standard IEC 61131-2 the values stated in the technical details for ambient temperature are reduced at heights >2000 m operating height above sea level (see [Supplementary data](#) [ 39]).

**EMC-compliant installation**

Intended use includes making the electrical installation EMC-compliant. Please refer to the guidelines stated in the "PSSuniversal Installation Manual". The module is intended for use in an industrial environment. Interference may occur if used within a domestic environment.

**Improper use**

The following is deemed improper use in particular

- Any component, technical or electrical modification to the module,
- Use of the module outside the areas described in this operating manual,
- Any use of the module that is not in accordance with the technical details.

**Software tools**

The modules PSSu E F 4DO 0.5 and PSSu E F 4DO 0.5-T are supported by:

- PSSuniversal Configurator and PSSuniversal Assistant from Version 1.4.0
- PAS4000 from Version 1.1.1

The module PSSu E F 4DO 0.5-R is supported by:

- PAS4000 from Version 1.5.0



**INFORMATION**

We recommend that you always use the latest version of the software tool (download from [www.pilz.com](http://www.pilz.com)).

### **Base modules**

The PSSu E F 4DO 0.5 module may be used in conjunction with the following base modules:

- ▶ PSSu BP 1/8 S
- ▶ PSSu BP 1/8 C
- ▶ PSSu BP-C 1/8 S
- ▶ PSSu BP-C 1/8 C
- ▶ PSSu BP 1/12 S
- ▶ PSSu BP 1/12 C
- ▶ PSSu BP-C1 1/12 S
- ▶ PSSu BP-C1 1/12 C

The PSSu E F 4DO 0.5-T and PSSu E F 4DO 0.5-R modules may be used in conjunction with the following base modules:

- ▶ PSSu BP 1/8 S-T
- ▶ PSSu BP 1/8 C-T
- ▶ PSSu BP-C 1/8 S-T
- ▶ PSSu BP-C 1/8 C-T
- ▶ PSSu BP 1/12 S-T
- ▶ PSSu BP 1/12 C-T
- ▶ PSSu BP-C1 1/12 S-T
- ▶ PSSu BP-C1 1/12 C-T

## **3.2 Safety regulations**

### **3.2.1 Use of qualified personnel**

The products may only be assembled, installed, programmed, commissioned, operated, maintained and decommissioned by persons who are competent to do so.

A competent person is a qualified and knowledgeable person who, because of their training, experience and current professional activity, has the specialist knowledge required. In order to inspect, assess and handle products, devices, systems, plant and machinery, this person must be familiar with the state of the art and the applicable national, European and international laws, directives and standards.

It is the company's responsibility only to employ personnel who

- ▶ Are familiar with the basic regulations concerning health and safety / accident prevention,
- ▶ Have read and understood the information provided in the section entitled Safety
- ▶ Have a good knowledge of the generic and specialist standards applicable to the specific application.

### **3.2.2 Warranty and liability**

All claims to warranty and liability will be rendered invalid if


- ▶ The product was used contrary to the purpose for which it is intended,
- ▶ Damage can be attributed to not having followed the guidelines in the manual,
- ▶ Operating personnel are not suitably qualified,
- ▶ Any type of modification has been made (e.g. exchanging components on the PCB boards, soldering work etc.).

### **3.2.3 Disposal**

- ▶ In safety-related applications, please comply with the mission time  $T_M$  in the safety-related characteristic data.
- ▶ When decommissioning, please comply with local regulations regarding the disposal of electronic devices (e.g. Electrical and Electronic Equipment Act).

## 4 Function description

### 4.1 Block diagram

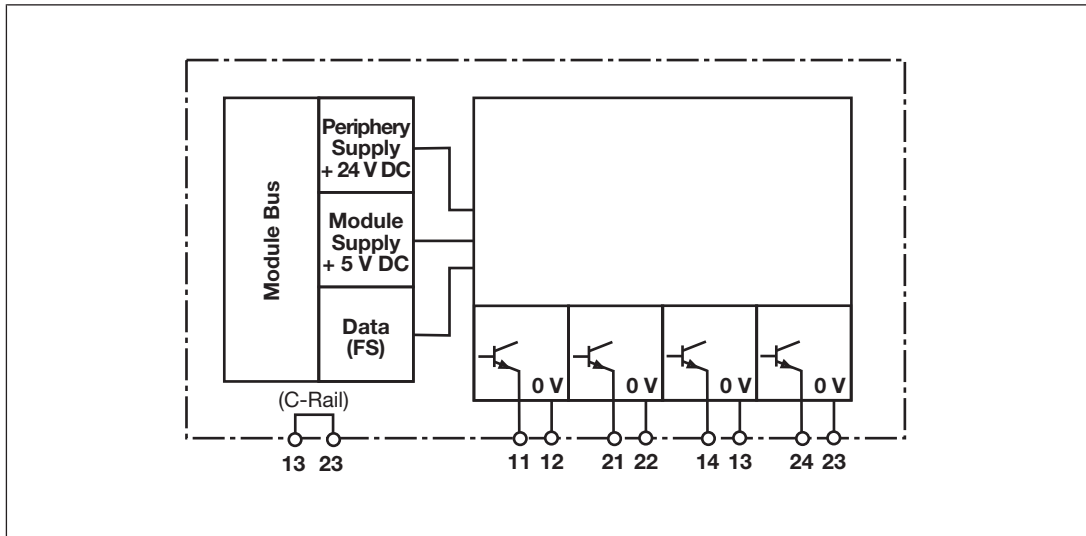

### 4.2 Module features

#### 4.2.1 Functions

Module supply

- ▶ The module supply provides the module with voltage.

Signals at the output

- ▶ "0" signal (0 V) at the output:
  - Output is high impedance
  - No current to the load
- ▶ "1" signal (+24 V) at the output:
  - Output is low impedance
  - Current is supplied to the load



Periphery supply

- ▶ The module routes the periphery supply from the module bus to the base module terminals.
- ▶ The periphery supply is used to supply the outputs.

Outputs

- ▶ The head module sets the output status via the module bus.
- ▶ The max. capacity at an output depends on the load (see characteristic). Connecting a higher capacity may lead to an error.
- ▶ Operation with electronic contactors has not been tested and may lead to errors. Please contact our Customer Support team if you are using electronic contactors.

#### Output test

- ▶ Outputs that are switched on are checked via regular off tests.
  - Test pulses for outputs that are switched on, see [Technische Daten](#) [ 38]
  - Outputs that are switched on are switched off for the duration of the test pulse.
  - The load must not switch off because of the test.
- ▶ Outputs that are switched off are checked via regular on tests.
  - Test pulses for outputs that are switched off, see [Technische Daten](#) [ 38]
  - Outputs that are switched off are switched on for the duration of the test pulse.
  - The load must not switch on because of the test.

#### Exclude individual outputs from the output test:

- ▶ If a plant is particularly sensitive to the test pulses, they may be switched off for individual outputs.
- ▶ The test must be replaced by other measures, depending on the safety requirement.
- ▶ When test pulses are switched off:
  - The correct switch state is always checked.
  - The output's ability to switch will not be detected until the next time the output is switched on/off.

#### Testing for shorts


- ▶ A test is regularly carried out to check for shorts between the outputs.
- ▶ For applications in accordance with Category 4, PL e and SIL 3, detection of shorts between contacts must be guaranteed either via the on/off test or through other measures (e.g. asynchronous switching). A short between contacts must be simulated during commissioning.



#### **WARNING!**


When wiring an output with capacitance it is essential to note the pulse duration, repetition period and scan time of the power-up test, otherwise the load may switch on unintentionally.

Timing diagram

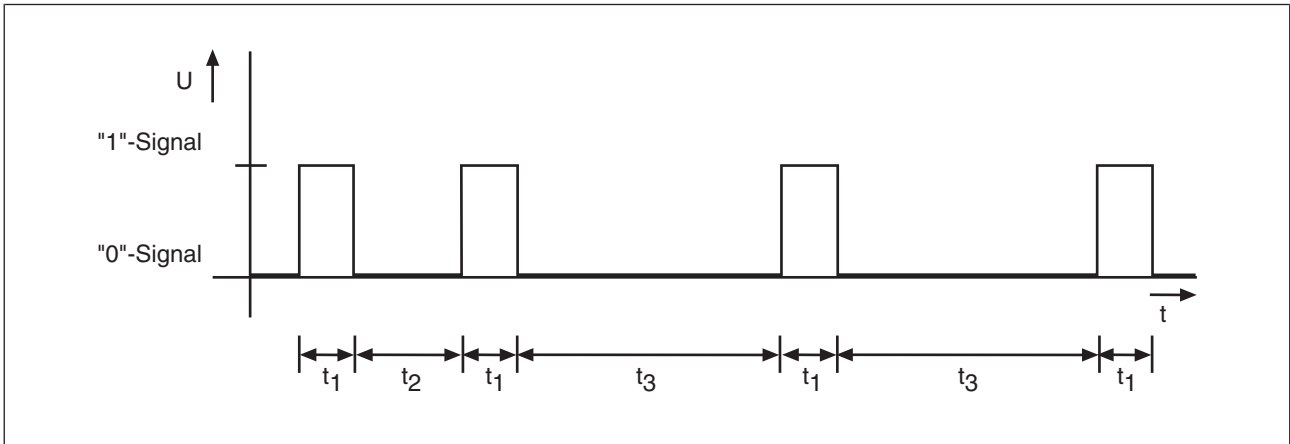


- ▶  $t_1$  Pulse duration on on test (see Technical details)
- ▶  $t_2$  Cycle time of on test when test is repeated (ca. 4 ms)
- ▶  $t_3$  Cycle time of on test in normal circumstances (approx. 5 min.)

Characteristic: Output capacitance C dependent on load current I

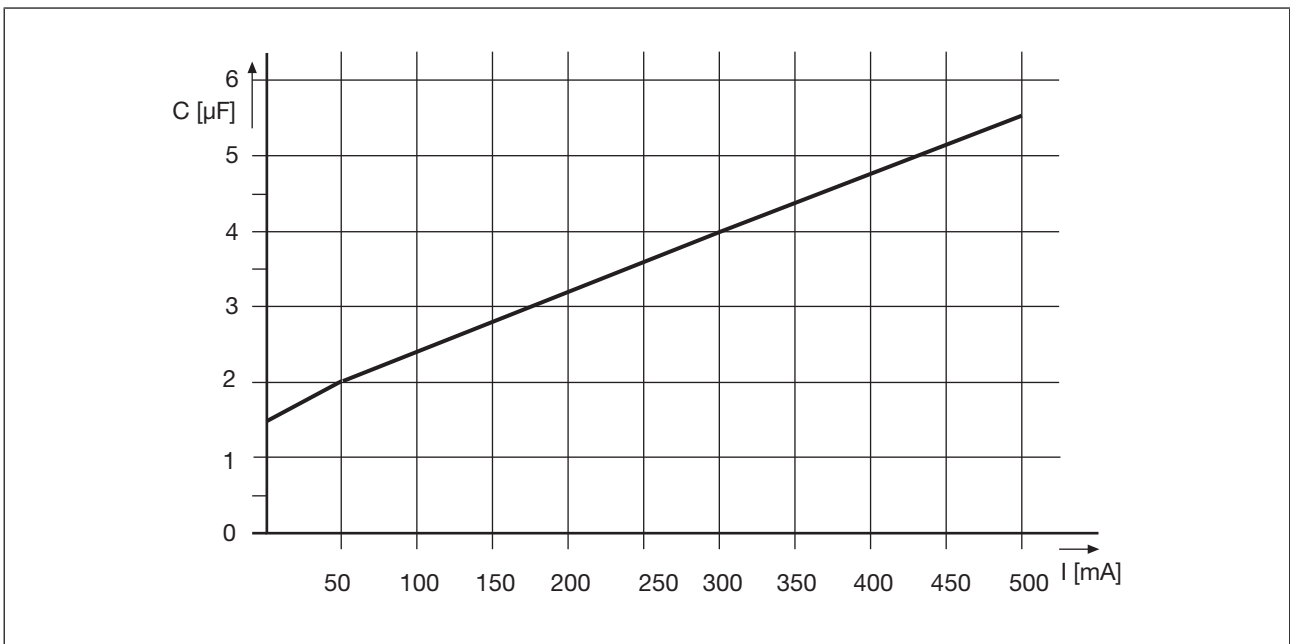



Derating diagram (PSSu E F 4DO 0.5(-T)(-R)): Permitted ambient temperature  $T$  dependent on load current  $I$

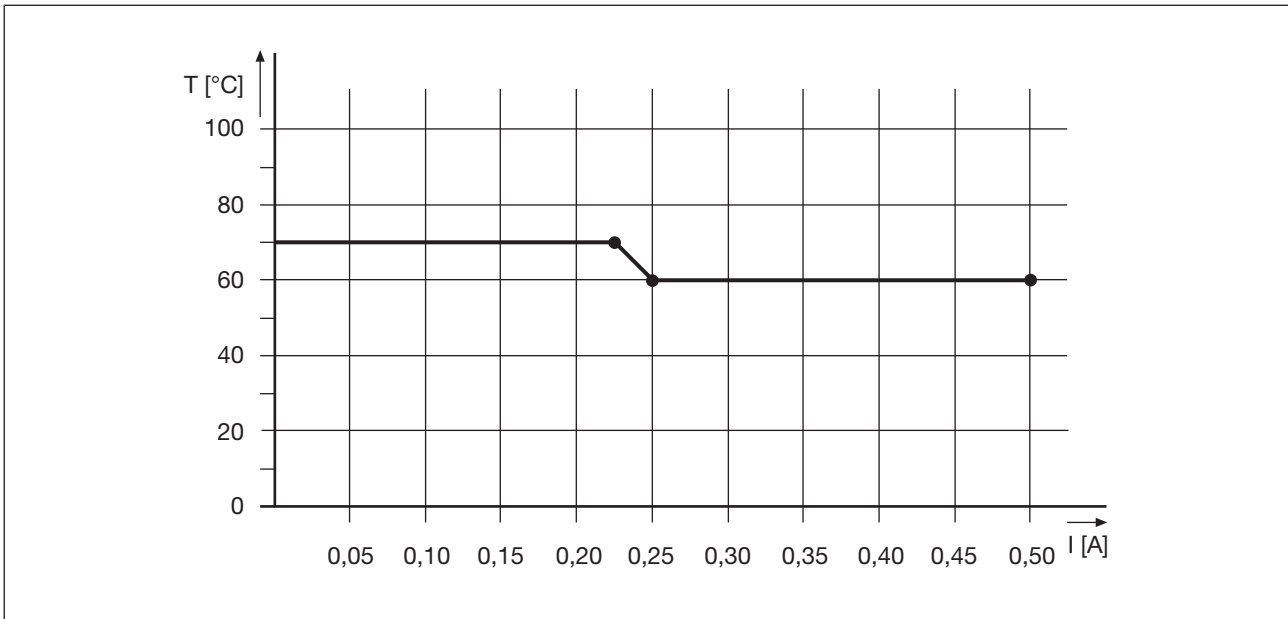

#### 4.2.2 Integrated protection mechanisms

When the PSSu E F PS1(-T) or PSSu E F PS2(-T)(-R) is used to supply the system, the module supply is buffered for 20 ms if the supply voltage is interrupted.

The module has the following protection mechanisms:

- ▶ Common second shutdown route, tested regularly
- ▶ Cyclical output tests
- ▶ Tests for shorts between the outputs

The module provides the following diagnostic data:

- ▶ Start-up error
- ▶ Configuration error
- ▶ FS communication error
- ▶ Bus termination error
- ▶ Temperature error: too warm
- ▶ Temperature error: too hot
- ▶ Output error

#### 4.2.3 Reaction times

Information on the reaction times of the outputs can be found in the PSSuniversal System Description.

## 4.3 Configuration

### 4.3.1 PSSu assignment in system environment A

Functions for the FS outputs of a PSSu are defined in the PSSuniversal Configurator on the PSS WIN-PRO system software:

- ▶ Read access through the standard bus system  
(configured per module):  
Configuration "R"
- ▶ Read/write access through the standard bus system  
(configured per FS output):  
"&" configuration (local enable principle)
- ▶ Optimisation of ST process image by combining adjacent bits of the same type.  
Configuration "\*"
- ▶ Exclude individual outputs from the output test  
(configured per FS output).

#### 4.3.1.1 Addresses in the process image

The module occupies 4 consecutive bit addresses in the process image. The process image in which the outputs are shown depends on the configuration.

With write access ("&"), the Bits in the ST-PIO are used to switch the FS outputs with the local enable principle.

Configuration	SafetyBUS p	Standard bus system	
		ST-PII	ST-PIO
	FS-PIO		
None	4 Bit (e. g.: 32.00 ... 32.03)	- - -	- - -
Read ST ("R")		4 Bit	- - -
ST read and write ("&")		4 Bit	4 Bit

### 4.3.2 PSSu assignment in system environment B

Data access is via pre-defined I/O data types:

I/O data name	I/O data type	I/O data element	Meaning
O0(11), O1(21), O2(14), O3(24)	FS_O_DO	Data: SAFEBOOL	Output data O0 ... O3

## 5 Installation

### 5.1 General installation guidelines

Please also refer to the PSSuniversal Installation Manual.




#### NOTICE

Damage due to electrostatic discharge!


Electrostatic discharge can damage components. Ensure against discharge before touching the product, e.g. by touching an earthed, conductive surface or by wearing an earthed armband.

#### 5.1.1 Dimensions

Base modules with four connection levels:

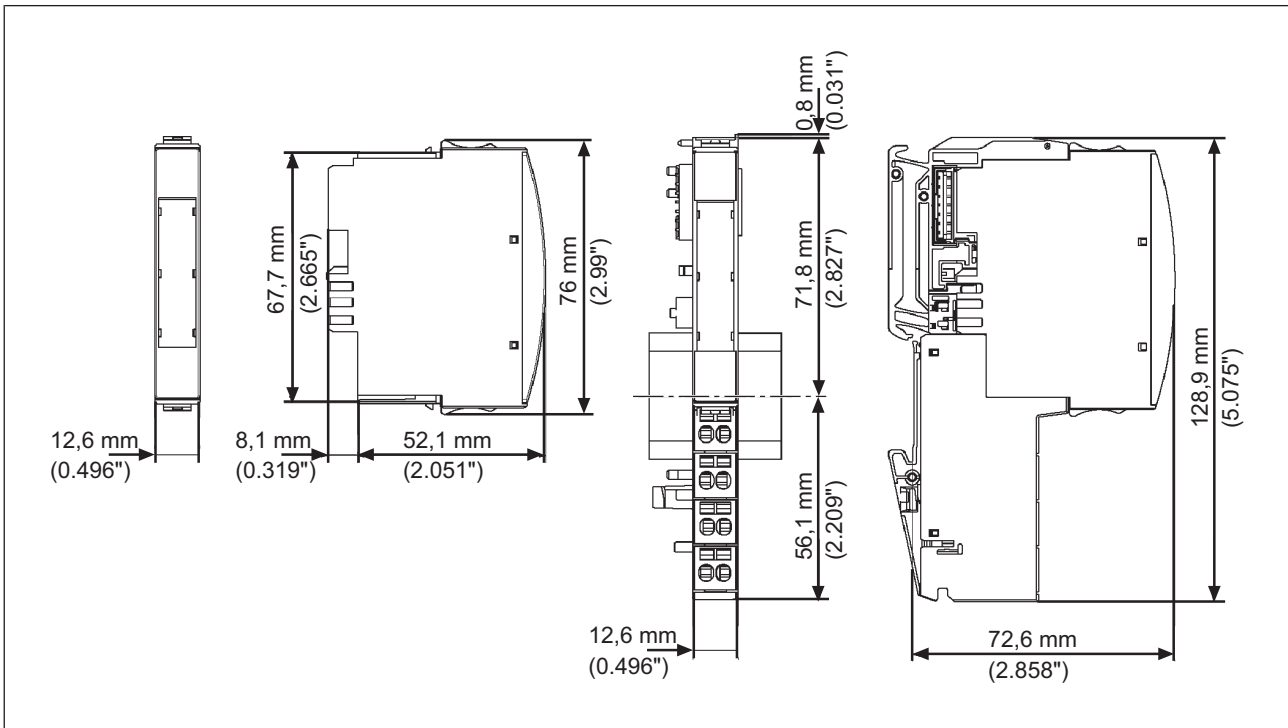

Base modules with six connection levels:

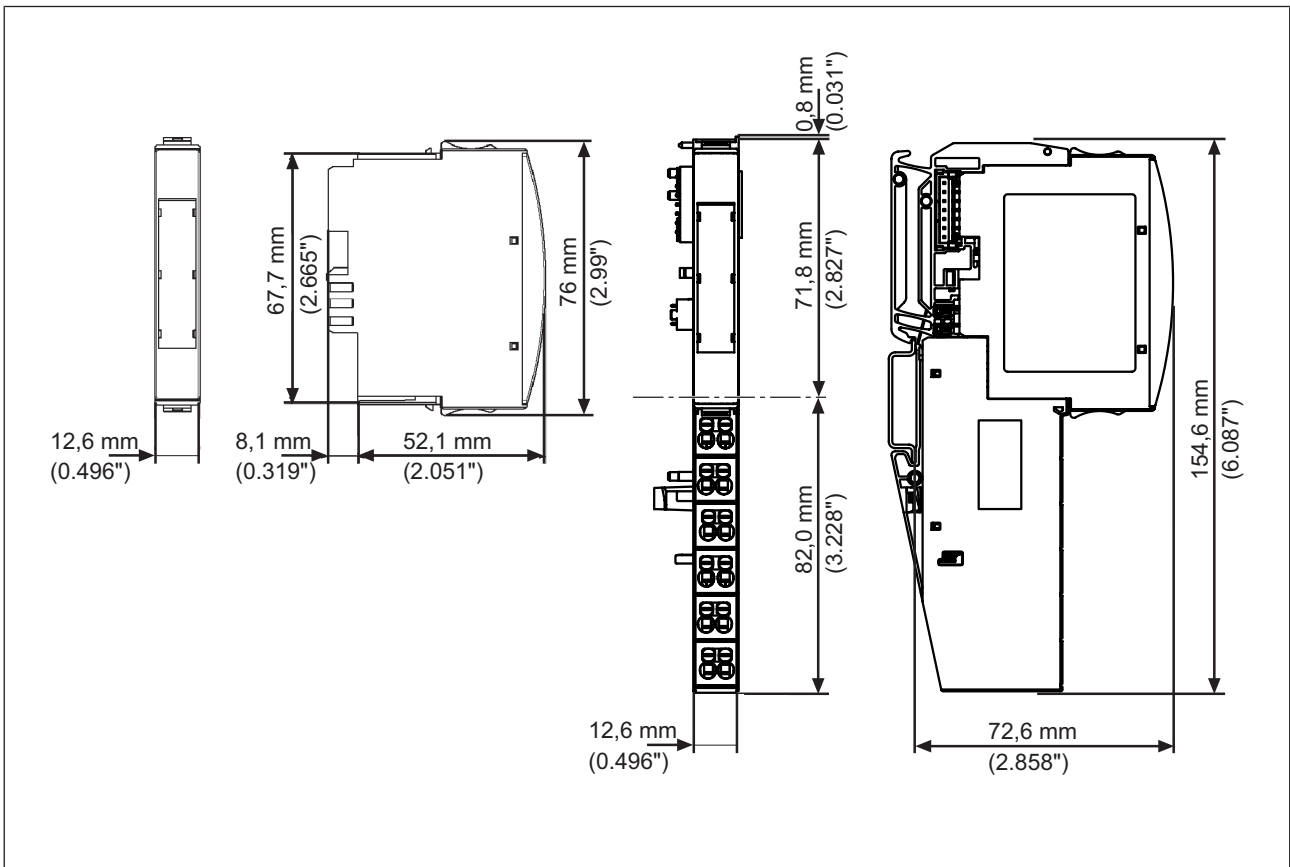

## 5.2 Installing the base module

Prerequisite:

- ▶ The head module must be installed.
- ▶ If the head module does not have an integrated power supply, a supply voltage module must be installed to the right of the head module.


Please note:

- ▶ For mechanical reasons it is not possible to mix base modules with screw terminals and base modules with cage clamp terminals.
- ▶ All contacts should be protected from contamination.
- ▶ The mechanics of the base modules are designed for 50 plug in/out cycles.

Procedure:

- ▶ We recommend that you wire up the base modules before inserting the electronic modules.
- ▶ Slot the groove on the base module on to the mounting rail from below [1].
- ▶ Push the base module back [2] until you hear it lock into position.
- ▶ On the mounting rail, slide the base module to the left until you hear the two lateral mounting hooks on the adjacent module lock into position [3].

Schematic representation:

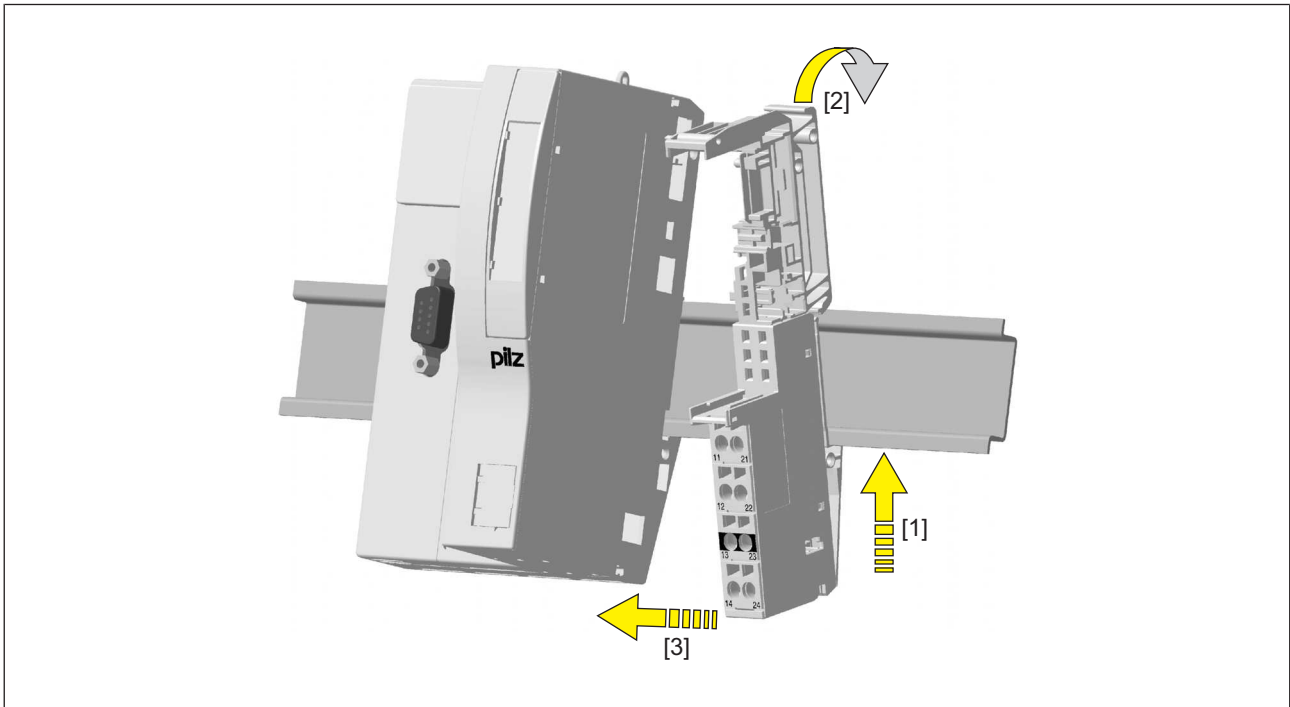

### 5.3 Inserting and removing an electronic module

Please note:


- ▶ Only insert on to base modules that are already installed.
- ▶ Preferably these base modules should be ready wired.
- ▶ Electronic modules with outputs may only be inserted and removed when the load is switched off. Unforeseeable error reactions may be triggered if modules are inserted and removed under load.
- ▶ When an electronic module is plugged into a base module for the first time, one part of the coding element remains on the electronic module, while its counterpart is fixed on to the base module. This is how the base module is coded.
- ▶ The mechanics of the electronic modules are designed for 50 plug in/out cycles.

### 5.3.1 Inserting an electronic module

Procedure:

- ▶ The electronic module must audibly lock into position [1].
- ▶ Mark the electronic module using the labelling strips [2].

Schematic representation:

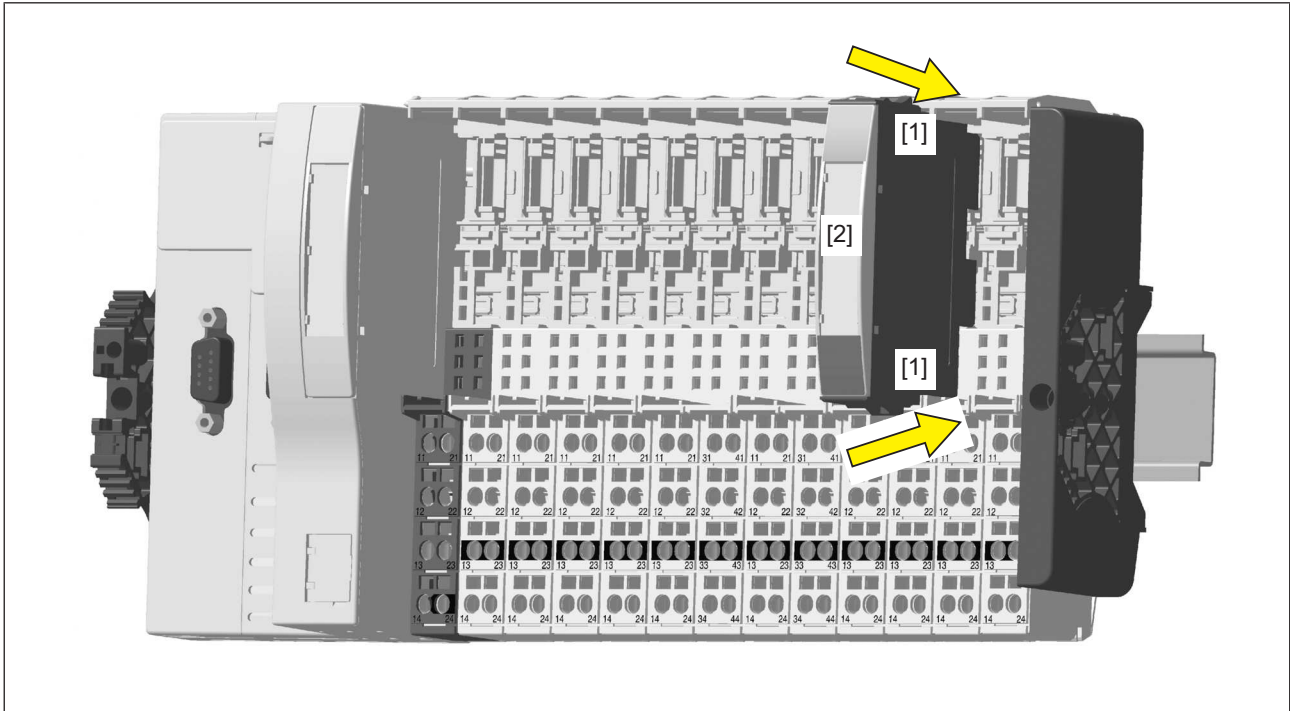


### 5.3.2 Removing an electronic module

Procedure:

- ▶ Press the locking mechanisms [1] together simultaneously.
- ▶ Pull out the electronic module [2].

Schematic representation:

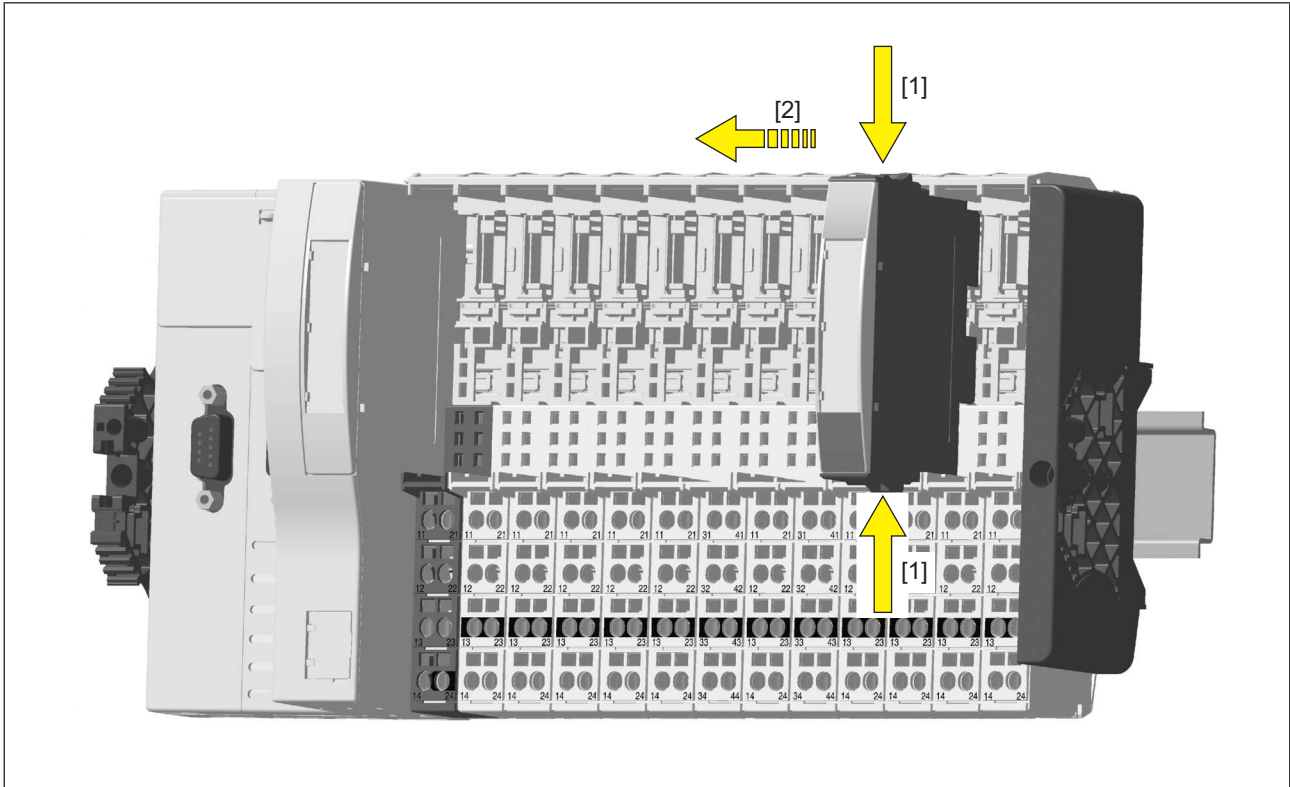

### 5.3.3 Changing an electronic module during operation

It is possible to change an electronic module during operation. The configuration data is retained when a module is changed.

Effects:

- ▶ System environment A:
  - In the event of a potential FS communication error, the FS section of the PSSu system and all relevant I/O-Groups (SafetyBUS p) switch to a STOP condition.
- ▶ System environment B:
  - All FS hardware outputs on the PSSu system switch to a safe condition.
  - The substitute values are used for the modules' FS outputs, with Valid Bits = FALSE.



#### CAUTION!

Sparking can cause interference and errors!

Only change the module when the load is switched off!

## 6 Wiring

### 6.1 General wiring guidelines


Please note:

- ▶ If short circuits occur between the cable from the output to the load and a supply line, it will no longer be possible to switch off the load. Possible remedies:
  - Exclude the error by using separate multicore cable for supply voltages
  - Use dual actuators, e.g. two contactors in series
  - Use an additional shutdown device such as a main contactor
- ▶ Use appropriate wiring to exclude short circuits between the outputs!
- ▶ The actuators may be connected using unshielded cables.
- ▶ The outputs do not need suppression for inductive loads.
- ▶ Use copper wiring.
- ▶ The terminal configuration as stated on the front plate applies for base modules with C-rail. The terminal configuration as stated in the technical documentation applies for all other base modules.

#### 6.1.1 Mechanical connection of the base modules

Procedure:



- ▶ Use a flat blade screwdriver (DIN 5264-A)!

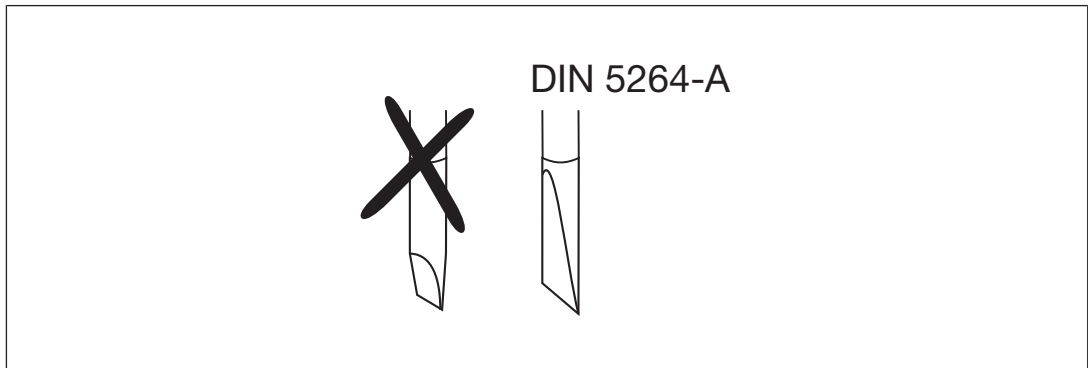

- ▶ Strip the wire back 8 mm.
- ▶ If necessary, label the connection level with a colour marker [3].
- ▶ Base module with screw terminals:
  - Use a screwdriver to loosen the screw on the screw terminal [1]
  - Insert the stripped cable into the round fixing hole [2], as far as it will go.
  - Tighten up the screw on the screw terminal.
  - Check that the cable is firmly seated.
- ▶ Base module with cage clamp terminals:
  - Insert the screwdriver [4] into the square hole [1].
  - Insert the stripped cable into the round fixing hole [2], as far as it will go [5].
  - Pull out the screwdriver [6].



- Check that the cable is firmly seated.

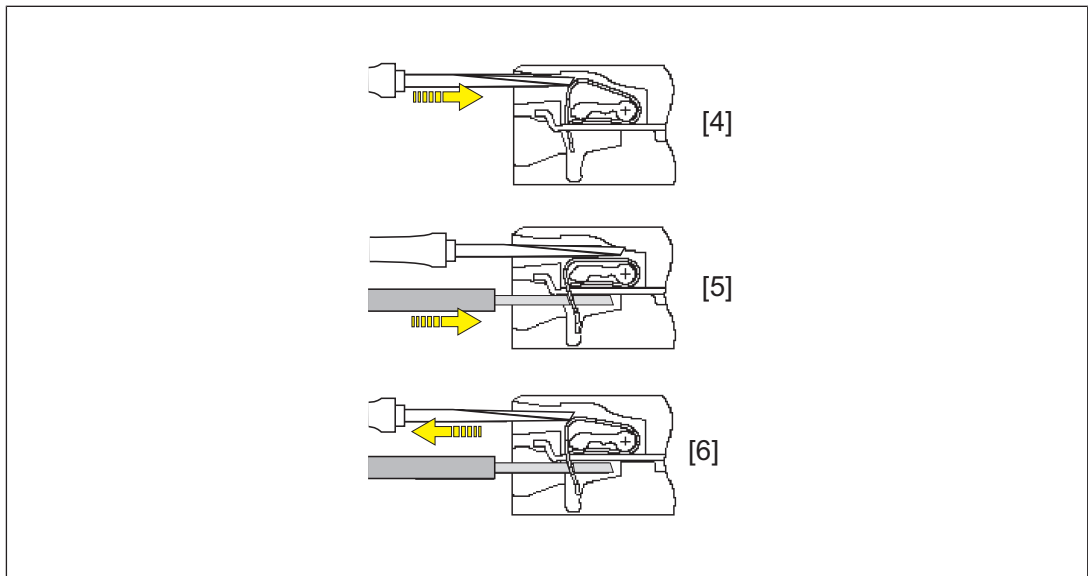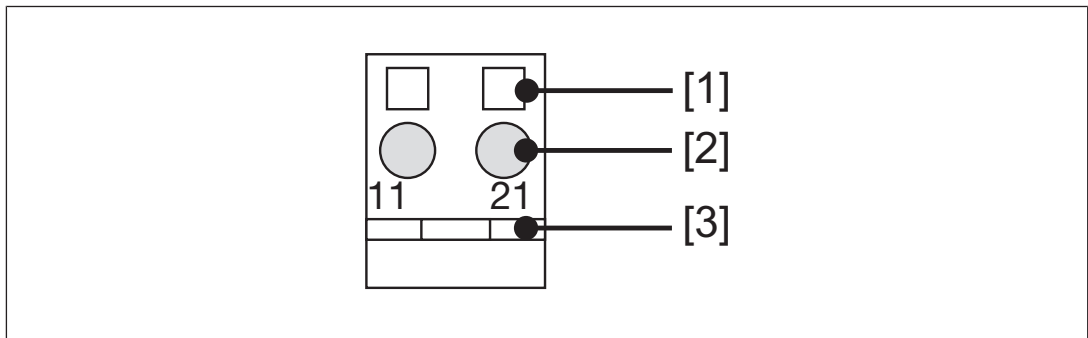


Please note:

- ▶ The minimum cable cross section for field connection terminals on the base modules is 0.14 mm<sup>2</sup> (AWG26).
- ▶ The maximum cable cross section for field connection terminals is:
  - Digital inputs: 1.5 mm<sup>2</sup> (AWG16)
  - Digital outputs: 2.0 mm<sup>2</sup> (AWG14)
  - Inputs/outputs on the counter modules: 1.5 mm<sup>2</sup> (AWG16)
  - Analogue inputs/outputs: 1.5 mm<sup>2</sup> (AWG16)
  - Communication cables: 1.5 mm<sup>2</sup> (AWG16)
  - Test pulse outputs: 1.5 mm<sup>2</sup> (AWG16)
  - Power supply: 2.5 mm<sup>2</sup> (AWG12)
  - Functional earth: 2.5 mm<sup>2</sup> (AWG12)
- ▶ On base modules with screw terminals:
  - If you use a multi-strand cable to connect the I/Os, it is recommended that you use ferrules conforming to Parts 1 and 2 of DIN 46228, 0.14 ... 1.5 mm<sup>2</sup>, Form A or C, although this is not essential. To crimp the ferrules you can use crimp pliers (crimp form A or C) conforming to EN 60947-1, such as the PZ 1.5 or PZ 6.5 from Weidmüller, for example.

- Maximum torque setting: 0.8 Nm
- ▶ Use copper wiring.


## 6.2 Terminal configuration

Base module	Terminal configuration	
<p>Screw terminals: PSSu BP 1/8 S PSSu BP 1/8 S-T</p> <p>Cage clamp terminals: PSSu BP 1/8 C PSSu BP 1/8 C-T</p>	<p>Without C-rail:</p> <p>11: Output O0</p> <p>21: Output O1</p> <p>12-22: 0 V periphery supply (12-22 linked within the base module)</p> <p>13-23: 0 V periphery supply (13-23 linked within the base module)</p> <p>14: Output O2</p> <p>24: Output O3</p>	
<p>Screw terminals: PSSu BP-C 1/8 S PSSu BP-C 1/8 S-T</p> <p>Cage clamp terminals: PSSu BP-C 1/8 C PSSu BP-C 1/8 C-T</p>	<p>With C-rail:</p> <p>11: Output O0</p> <p>21: Output O1</p> <p>12-22: 0 V periphery supply (12-22 linked within the base module)</p> <p>13-23: C-rail supply (13-23 linked within the base module)</p> <p>14: Output O2</p> <p>24: Output O3</p>	

Base module	Terminal configuration	
<p>Screw terminals: PSSu BP-C1 1/12 S PSSu BP-C1 1/12 S-T</p> <p>Cage clamp terminals: PSSu BP-C1 1/12 C PSSu BP-C1 1/12 C-T</p>	<p>With C-rail:</p> <p>11: Output O0</p> <p>21: Output O1</p> <p>12-22: 0 V periphery supply (12-22 linked within the base module)</p> <p>13-23: C-rail supply (13-23-16-26 linked within the base module)</p> <p>14: Output O2</p> <p>24: Output O3</p> <p>15-25: 0 V periphery supply (15-25 linked within the base module)</p> <p>16-26: C-rail supply (13-23-16-26 linked within the base module)</p>	

### 6.3 Connecting the module

Output circuit	Without C-rail	With C-rail
Single-channel actuator		
Single-channel actuator		

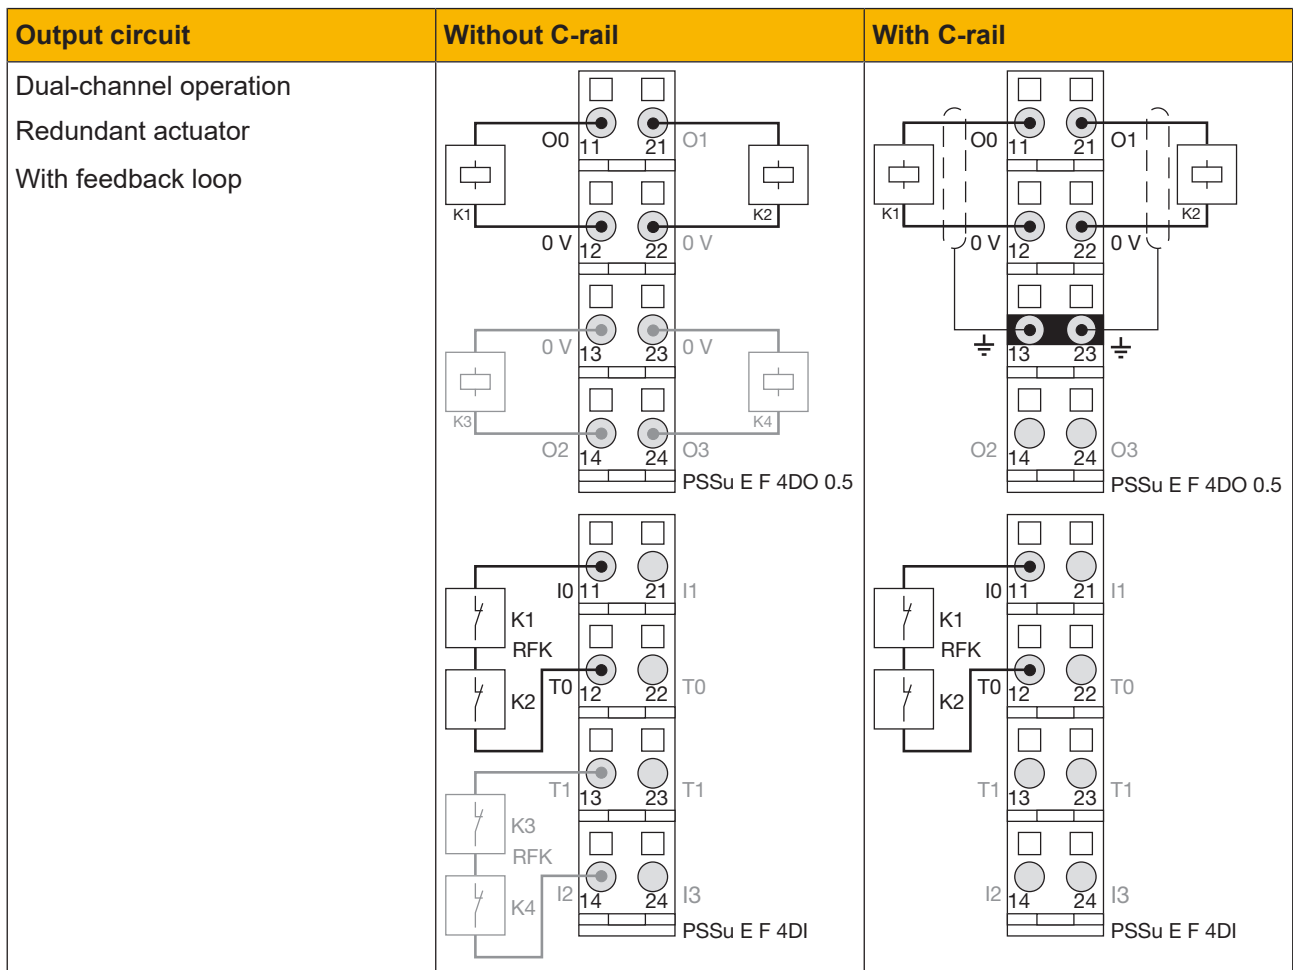

## 6.4 Function test during commissioning

An error must be simulated for each safety-related output during commissioning: The anticipated error reaction must occur when an output has a short circuit to a supply voltage.



### INFORMATION

The short circuit test must be performed on the load and not on the output terminal.

# 7 Operation

## 7.1 Messages

A module error is displayed via the "Err" LED (see section entitled "Display elements"). It is signalled to the head module and then entered in the

- ▶ Error stack, with PSSu in system environment A
- ▶ Diagnostic log, with PSSu in system environment B.

of the head module.

The module can detect the following errors:

Module error	Statement	Remedy
Start-up error	Error as the PSSu system starts up	Change faulty module.
Configuration error	Incorrect module type configured.	The configured hardware registry does not match the actual hardware registry.
FS communication error	Error during FS communication	Change faulty module.
Bus termination error	There is no terminating plate or there is a bad contact with the module bus.	Install a terminating plate with integrated end bracket or insert the base modules together correctly.
Temperature error: too warm <sup>(1)</sup>	Ambient temperature too high: Error stack entry/diagnostic log entry	Ensure there is sufficient ventilation in the control cabinet or prevent overload.
Temperature error: too hot <sup>(1)</sup>	Ambient temperature too high: Reset the module and stop the affected I/O-Groups (SafetyBUS p)	Ensure there is sufficient ventilation in the control cabinet or prevent overload.
Output error	Error during cyclical output test for short circuit. Possible causes: Short circuit, or output defective.	Rectify the short circuit or change the faulty module.
Error in the (local) enable principle	FS output has reacted incorrectly or unexpectedly	Check configuration.

<sup>(1)</sup> There are two levels of overtemperature.

- ▶ Too warm:

If a module's temperature exceeds a threshold value, the module sends a warning to the head module. If the temperature drops back below the threshold value, the module sends an all-clear.

- ▶ Too hot:

If a module's temperature exceeds a further threshold value, the module sends an error message to the head module and triggers an I/O-Group stop.




## 7.2 Display elements

### Legend

-  LED on
-  LED off










### 7.2.1 Display elements for module diagnostics

The module has an LED for displaying module errors ("Err" LED).

	LED			Meaning
	Name	Colour	Status	
	Err	---		No error
	Red		Module error	

### 7.2.2 Display elements for an output's FS enable


With the local enable principle (system environment A) or the enable principle (system environment B), FS outputs are activated via an ST section. An FS enable is assigned to each of these FS outputs. The status of that enable is displayed via the enable LEDs ("FS0", "FS1", "FS2" and "FS3").

	LED			Key
	Description	Colour	State	
	FS0	---		No FS enable for output O0
		Yellow		FS enable for output O0
	FS1	---		No FS enable for output O1
		Yellow		FS enable for output O1
	FS2	---		No FS enable for output O2
		Yellow		FS enable for output O2
	FS3	---		No FS enable for output O3
		Yellow		FS enable for output O3



### 7.2.3 Display elements for output status

Each output is assigned an LED for displaying the output status (LEDs “11”, “21”, “14” and “24”).

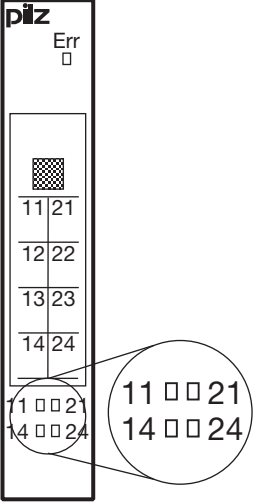	LED			Meaning		
	Designation	Colour	Status	Signal	Output	Terminal
11	---	●	0 signal	O0 (Output 0)	11	
	Green	☀	1 signal			
21	---	●	0 signal	O1 (Output 1)	21	
	Green	☀	1 signal			
14	---	●	0 signal	O2 (Output 2)	14	
	Green	☀	1 signal			
24	---	●	0 signal	O3 (Output 3)	24	
	Green	☀	1 signal			

## 8 Technical details

<b>General</b>	<b>312210</b>	<b>314210</b>	<b>315210</b>
Certifications	<b>CE, EAC, KOSHA, TÜV, UKCA, cULus Listed</b>	<b>CE, EAC, KOSHA, TÜV, UKCA, cULus Listed</b>	<b>CE, EAC, TÜV, UKCA</b>
Application range	<b>Failsafe</b>	<b>Failsafe</b>	<b>Failsafe</b>
Module's device code	<b>0C01h</b>	<b>0C01h</b>	<b>0C01h</b>
Number of FS output bits	<b>4</b>	<b>4</b>	<b>4</b>
Application in system environment A			
from FS firmware version, other head modules	<b>4</b>	<b>4</b>	–
from FS firmware version PSSu H F PN	<b>1</b>	<b>1</b>	–
Application in system environment B			
from FS firmware version, head modules	<b>1.0.0</b>	<b>1.0.0</b>	<b>1.5.0</b>
<b>Electrical data</b>	<b>312210</b>	<b>314210</b>	<b>315210</b>
Internal supply voltage (module supply)			
Module's power consumption	<b>0,28 W</b>	<b>0,28 W</b>	<b>0,28 W</b>
Periphery's supply voltage (periphery supply)			
Voltage range	<b>16,8 - 30 V</b>	<b>16,8 - 30 V</b>	<b>16,8 - 30 V</b>
Module's current consumption with no load	<b>37 mA</b>	<b>37 mA</b>	<b>37 mA</b>
Module's power consumption with no load	<b>0,9 W</b>	<b>0,9 W</b>	<b>0,9 W</b>
Max. power dissipation of module	<b>1,5 W</b>	<b>1,5 W</b>	<b>1,5 W</b>
Terminal voltage when switching off inductive loads	<b>U2 - 50 V</b>	<b>U2 - 50 V</b>	<b>U2 - 50 V</b>
Permitted loads	<b>inductive, capacitive, resistive</b>	<b>inductive, capacitive, resistive</b>	<b>inductive, capacitive, resistive</b>
<b>Semiconductor outputs</b>	<b>312210</b>	<b>314210</b>	<b>315210</b>
Number of positive-switching single-pole semiconductor outputs	<b>4</b>	<b>4</b>	<b>4</b>
Rated voltage	<b>24 V DC</b>	<b>24 V DC</b>	<b>24 V DC</b>
Typ. output current at "1" signal and rated voltage of semiconductor output	<b>0,5 A</b>	<b>0,5 A</b>	<b>0,5 A</b>
Permitted current range	<b>0,000 - 0,620 A</b>	<b>0,000 - 0,620 A</b>	<b>0,000 - 0,620 A</b>
Residual current at "0" signal	<b>0,02 mA</b>	<b>0,02 mA</b>	<b>0,02 mA</b>

<b>Semiconductor outputs</b>	<b>312210</b>	<b>314210</b>	<b>315210</b>
Max. transient pulsed current	<b>6 A</b>	<b>6 A</b>	<b>6 A</b>
Max. internal voltage drop	<b>300 mV</b>	<b>300 mV</b>	<b>300 mV</b>
Monitoring threshold of semiconductor output	<b>6 V</b>	<b>6 V</b>	<b>6 V</b>
Max. duration of on time during self test	<b>200 µs</b>	<b>200 µs</b>	<b>200 µs</b>
Max. duration of off time during self test	<b>350 µs</b>	<b>350 µs</b>	<b>350 µs</b>
Max. processing time of semiconductor output when signal changes from "1" to "0"	<b>0,02 ms</b>	<b>0,02 ms</b>	<b>0,02 ms</b>
Max. processing time of semiconductor output when signal changes from "0" to "1"	<b>0,01 ms</b>	<b>0,01 ms</b>	<b>0,01 ms</b>
Potential isolation from system voltage	<b>Yes</b>	<b>Yes</b>	<b>Yes</b>
Short circuit-proof	<b>Yes</b>	<b>Yes</b>	<b>Yes</b>
<b>Environmental data</b>	<b>312210</b>	<b>314210</b>	<b>315210</b>
Application site			
in accordance with the standard	–	–	<b>EN 50125-3</b>
Application site	–	–	<b>Track area (1 m - 3 m)</b>
in accordance with the standard	–	–	<b>EN 61373</b>
Application site	–	–	<b>Category 1, Class A + B</b>
Climatic suitability	<b>EN 60068-2-1, EN 60068-2-14, EN 60068-2-2, EN 60068-2-30, EN 60068-2-78</b>	<b>EN 60068-2-1, EN 60068-2-14, EN 60068-2-2, EN 60068-2-30, EN 60068-2-78</b>	<b>EN 50125-1, EN 50125-3, EN 50155, EN 60068-2-1, EN 60068-2-14, EN 60068-2-2</b>
Ambient temperature			
in accordance with the standard	<b>EN 60068-2-14</b>	<b>EN 60068-2-14</b>	<b>EN 50155</b>
Temperature range	<b>0 - 60 °C</b>	<b>-40 - 70 °C</b>	<b>-40 - 70 °C</b>
in accordance with the standard	–	–	<b>EN 50125-1</b>
Temperature range	–	–	<b>-40 ... +70 °C</b>
in accordance with the standard	–	–	<b>EN 50125-3</b>
Temperature range	–	–	<b>-40 ... +70 °C</b>
Storage temperature			
in accordance with the standard	<b>EN 60068-2-1/-2</b>	<b>EN 60068-2-1/-2</b>	<b>EN 60068-2-1/-2</b>
Temperature range	<b>-40 - 70 °C</b>	<b>-40 - 70 °C</b>	<b>-40 - 70 °C</b>

<b>Environmental data</b>	<b>312210</b>	<b>314210</b>	<b>315210</b>
Climatic suitability			
in accordance with the standard	<b>EN 60068-2-78</b>	<b>EN 60068-2-78</b>	<b>EN 60068-2-78</b>
Humidity	<b>93 % r. h. at 40 °C</b>	<b>93 % r. h. at 40 °C</b>	<b>97 % r. h. at 40 °C</b>
Condensation during operation	<b>Not permitted</b>	<b>EN 60068-2-30, short-term</b>	<b>EN 50155, EN 60068-2-30, short-term</b>
Max. operating height above SL	<b>2000 m</b>	<b>5000 m</b>	<b>2000 m</b>
Max. operating height above sea level in accordance with EN 81-1, EN 81-2 and EN 115-1	<b>2000 m</b>	<b>2000 m</b>	–
EMC	<b>EN 12015, EN 12016, EN 61000-6-2, EN 61000-6-4, EN 61131-2 (Zone B)</b>	<b>EN 12015, EN 12016, EN 61000-6-2, EN 61000-6-4, EN 61131-2 (Zone B)</b>	<b>EN 50121-3-2, EN 50124-1, EN 61000-6-2, EN 61000-6-4</b>
Vibration			
in accordance with the standard	<b>EN 60068-2-6</b>	<b>EN 60068-2-6</b>	–
Frequency	<b>10 - 150 Hz</b>	<b>10 - 150 Hz</b>	–
Acceleration	<b>10 m/s<sup>2</sup></b>	<b>10 m/s<sup>2</sup></b>	–
Broadband noise			
in accordance with the standard	–	<b>EN 60068-2-64</b>	–
Frequency	–	<b>5 - 500 Hz</b>	–
Acceleration	–	<b>19 m/s<sup>2</sup> eff.</b>	–
in accordance with the standard	–	–	<b>EN 61373</b>
Frequency	–	–	<b>5 ... 150 Hz</b>
Acceleration	–	–	<b>7,9 m/s<sup>2</sup> eff.</b>
in accordance with the standard	–	–	<b>EN 50125-3</b>
Frequency	–	–	<b>5 - 2.000 Hz</b>
Acceleration	–	–	<b>2,3 m/s<sup>2</sup> eff.</b>

<b>Environmental data</b>	<b>312210</b>	<b>314210</b>	<b>315210</b>
<b>Shock stress</b>			
in accordance with the standard	<b>EN 60068-2-27</b>	<b>EN 60068-2-27</b>	–
Number of shocks	<b>6</b>	<b>6</b>	–
Acceleration	<b>150 m/s<sup>2</sup></b>	<b>150 m/s<sup>2</sup></b>	–
Duration	<b>11 ms</b>	<b>11 ms</b>	–
in accordance with the standard	–	–	<b>EN 50125-3</b>
Number of shocks	–	–	<b>6</b>
Acceleration	–	–	<b>20 m/s<sup>2</sup></b>
Duration	–	–	<b>11 ms</b>
in accordance with the standard	–	–	<b>EN 61373</b>
Number of shocks	–	–	<b>6</b>
Acceleration	–	–	<b>50 m/s<sup>2</sup></b>
Duration	–	–	<b>30 ms</b>
<b>Airgap creepage</b>			
in accordance with the standard	<b>EN 61131-2</b>	<b>EN 61131-2</b>	<b>EN 50124-1</b>
Overvoltage category	<b>II</b>	<b>II</b>	<b>OV2</b>
Pollution degree	<b>2</b>	<b>2</b>	<b>PD2</b>
<b>Protection type</b>			
in accordance with the standard	<b>EN 60529</b>	<b>EN 60529</b>	–
Housing	<b>IP20</b>	<b>IP20</b>	–
Terminals	<b>IP20</b>	<b>IP20</b>	–
in accordance with the standard	–	–	<b>EN 60529</b>
Mounting area	–	–	<b>IP51</b>
Housing	–	–	<b>IP20</b>
Terminals	–	–	<b>IP20</b>
Mounting area (e.g. control cabinet)	<b>IP54</b>	<b>IP54</b>	–
<b>Mechanical data</b>	<b>312210</b>	<b>314210</b>	<b>315210</b>
<b>Material</b>			
Bottom	<b>PC</b>	<b>PC</b>	<b>PC</b>
Front	<b>PC</b>	<b>PC</b>	<b>PC</b>
Coding	<b>PA</b>	<b>PA</b>	<b>PA</b>
Mounting type	<b>plug-in</b>	<b>plug-in</b>	<b>plug-in</b>
<b>Dimensions</b>			
Height	<b>76 mm</b>	<b>76 mm</b>	<b>76 mm</b>
Width	<b>12,6 mm</b>	<b>12,6 mm</b>	<b>12,6 mm</b>
Depth	<b>60,2 mm</b>	<b>60,2 mm</b>	<b>60,2 mm</b>
Weight	<b>36 g</b>	<b>38 g</b>	<b>38 g</b>
<b>Mechanical coding</b>			
Type	<b>E</b>	<b>E</b>	<b>E</b>

Mechanical data	312210	314210	315210
Colour	Yellow	Yellow	Yellow

Where standards are undated, the 2022-01 latest editions shall apply.

## 8.1 Safety characteristic data



### NOTICE

You must comply with the safety characteristic data in order to achieve the required safety level for your plant/machine.

Operating mode	EN ISO 13849-1: 2015 PL	EN ISO 13849-1: 2015 Category	EN IEC 62061 SIL CL/ maximum SIL	EN IEC 62061 PFH <sub>D</sub> [1/h]	EN/IEC 61511 SIL	EN/IEC 61511 PFD	EN ISO 13849-1: 2015 T <sub>M</sub> [year]
1-channel	PL d	Cat. 2	SIL CL 2	9,00E-09	SIL 2	7,89E-04	20
2-channel	PL e	Cat. 4	SIL CL 3	1,13E-09	SIL 3	1,66E-05	20

If the module is operated at an ambient temperature above 60° C, the values stated in the table for PFH<sub>D</sub> and PFD will need to be doubled when a safety function is calculated.

All the units used within a safety function must be considered when calculating the safety characteristic data.



### INFORMATION

A safety function's SIL/PL values are **not** identical to the SIL/PL values of the units that are used and may be different. We recommend that you use the PAScal software tool to calculate the safety function's SIL/PL values.

## 9 Supplementary data

### 9.1 Permitted operating height

The values stated in the technical details apply to the use of the device in operating heights up to max. 2000 m above SL. When used at higher levels, restrictions of the ambient temperature (standard IEC 61131-2) must be taken into account.

Operating height above SL [m]	Multiplication factors for the devices' ambient temperature
0 ... 2000	1.0
3000	0.9
4000	0.8
5000	0.7

## 10 Order reference

### 10.1 Product

Product type	Features	Order no.
PSSu E F 4DO 0.5	Electronic module, base type	312210
PSSu E F 4DO 0.5-T	Electronic module, T-type	314210
PSSu E F 4DO 0.5-R	Electronic module, R-type	315210

### 10.2 Accessories

#### Base modules

Product type	Features	Order no.
PSSu BP 1/8 S	Base module without C-rail with screw terminals	312600
PSSu BP 1/8 S-T	Base module without C-rail with screw terminals, T-type	314600
PSSu BP 1/8 C	Base module without C-rail with cage clamp terminals	312601
PSSu BP 1/8 C-T	Base module without C-rail with cage clamp terminals, T-type	314601
PSSu BP-C 1/8 S	Base module with C-rail and screw terminals	312610
PSSu BP-C 1/8 S-T	Base module with C-rail and screw terminals, T-type	314610
PSSu BP-C 1/8 C	Base module with C-rail and cage clamp terminals	312611
PSSu BP-C 1/8 C-T	Base module with C-rail and cage clamp terminals, T-type	314611
PSSu BP 1/12 S	Base module without C-rail with screw terminals	312618
PSSu BP 1/12 S-T	Base module without C-rail with screw terminals, T-type	314618
PSSu BP 1/12 C	Base module without C-rail with cage clamp terminals	312619
PSSu BP 1/12 C-T	Base module without C-rail with cage clamp terminals, T-type	314619
PSSu BP-C1 1/12 S	Base module with C-rail and screw terminals	312622
PSSu BP-C1 1/12 S-T	Base module with C-rail and screw terminals, T-type	314622
PSSu BP-C1 1/12 C	Base module with C-rail and cage clamp terminals	312623
PSSu BP-C1 1/12 C-T	Base module with C-rail and cage clamp terminals, T-type	314623



## **11 EC declaration of conformity for PSSu E F 4DO 0.5 and PSSu E F 4DO 0.5-T**

This product/these products meet the requirements of the directive 2006/42/EC on machinery of the European Parliament and of the Council. The complete EC Declaration of Conformity is available on the Internet at [www.pilz.com/downloads](http://www.pilz.com/downloads).

Representative: Pilz GmbH & Co. KG, Felix-Wankel-Str. 2, 73760 Ostfildern, Germany

## 12 UKCA-Declaration of Conformity for PSSu E F 4DO 0.5 and PSSu E F 4DO 0.5-T

This product(s) complies with following UK legislation: Supply of Machinery (Safety) Regulation 2008.

The complete UKCA Declaration of Conformity is available on the Internet at [www.pilz.com/downloads](http://www.pilz.com/downloads).

Representative: Pilz Automation Technology, Pilz House, Little Colliers Field, Corby, Northamptonshire, NN18 8TJ United Kingdom, eMail: [mail@pilz.co.uk](mailto:mail@pilz.co.uk)

# ► Support

Technical support is available from Pilz round the clock.

## Americas

### Brazil

+55 11 97569-2804

### Canada

+1 888 315 7459

### Mexico

+52 55 5572 1300

### USA (toll-free)

+1 877-PILZUSA (745-9872)

## Asia

### China

+86 400-088-3566

### Japan

+81 45 471-2281

### South Korea

+82 31 778 3300

## Australia and Oceania

### Australia

+61 3 95600621

### New Zealand

+64 9 6345350

## Europe

### Austria

+43 1 7986263-444

### Belgium, Luxembourg

+32 9 3217570

### France

+33 3 88104003

### Germany

+49 711 3409-444

### Ireland

+353 21 4804983

### Italy, Malta

+39 0362 1826711

## Scandinavia

+45 74436332

## Spain

+34 938497433

## Switzerland

+41 62 88979-32

## The Netherlands

+31 347 320477

## Türkiye

+90 216 5775552

## United Kingdom

+44 1536 462203

## You can reach our international hotline on:

+49 711 3409-222

support@pilz.com

Pilz develops environmentally-friendly products using ecological materials and energy-saving technologies. Offices and production facilities are ecologically designed, environmentally-aware and energy-saving. So Pilz offers sustainability, plus the security of using energy-efficient products and environmentally-friendly solutions.



We are represented internationally. Please refer to our homepage [www.pilz.com](http://www.pilz.com) for further details or contact our headquarters.

Headquarters: Pilz GmbH & Co. KG, Felix-Wankel-Straße 2, 73760 Ostfildern, Germany  
Telephone: +49 711 3409-0, E-Mail: [info@pilz.com](mailto:info@pilz.com), Internet: [www.pilz.com](http://www.pilz.com)

**PILZ**  
THE SPIRIT OF SAFETY

CECE<sup>®</sup>, CHRE<sup>®</sup>, CMSE<sup>®</sup>, INDUSTRIAL P<sup>®</sup>, Leansafe<sup>®</sup>, Myzei<sup>®</sup>, PAS4000<sup>®</sup>, PASscal<sup>®</sup>, PASconfig<sup>®</sup>, Pilz<sup>®</sup>, PIT<sup>®</sup>, PMSprimo<sup>®</sup>, PMSprotego<sup>®</sup>, PMCiendo<sup>®</sup>, PMD<sup>®</sup>, PMI<sup>®</sup>, PNOZ<sup>®</sup>, Primo<sup>®</sup>, PSEN<sup>®</sup>, PSS<sup>®</sup>, PVS<sup>®</sup>, SafetyBUS p<sup>®</sup>, SafetyNET p<sup>®</sup>, THE SPIRIT OF SAFETY<sup>®</sup> are registered and protected trademarks of Pilz GmbH & Co. KG in some countries. We would point out that product features may vary from the details stated in this document, depending on the status at the time of publication and the scope of the equipment. We accept no responsibility for the validity, accuracy and entirety of the text and graphics presented in this information. Please contact our Technical Support if you have any questions.

213116-EN-10, 2023-08 Printed in Germany  
© Pilz GmbH & Co. KG, 2019